


**⚠ DANGER**  
 Keep away!  
 Will shock, burn or cause death. If found open, contact your local utility company.

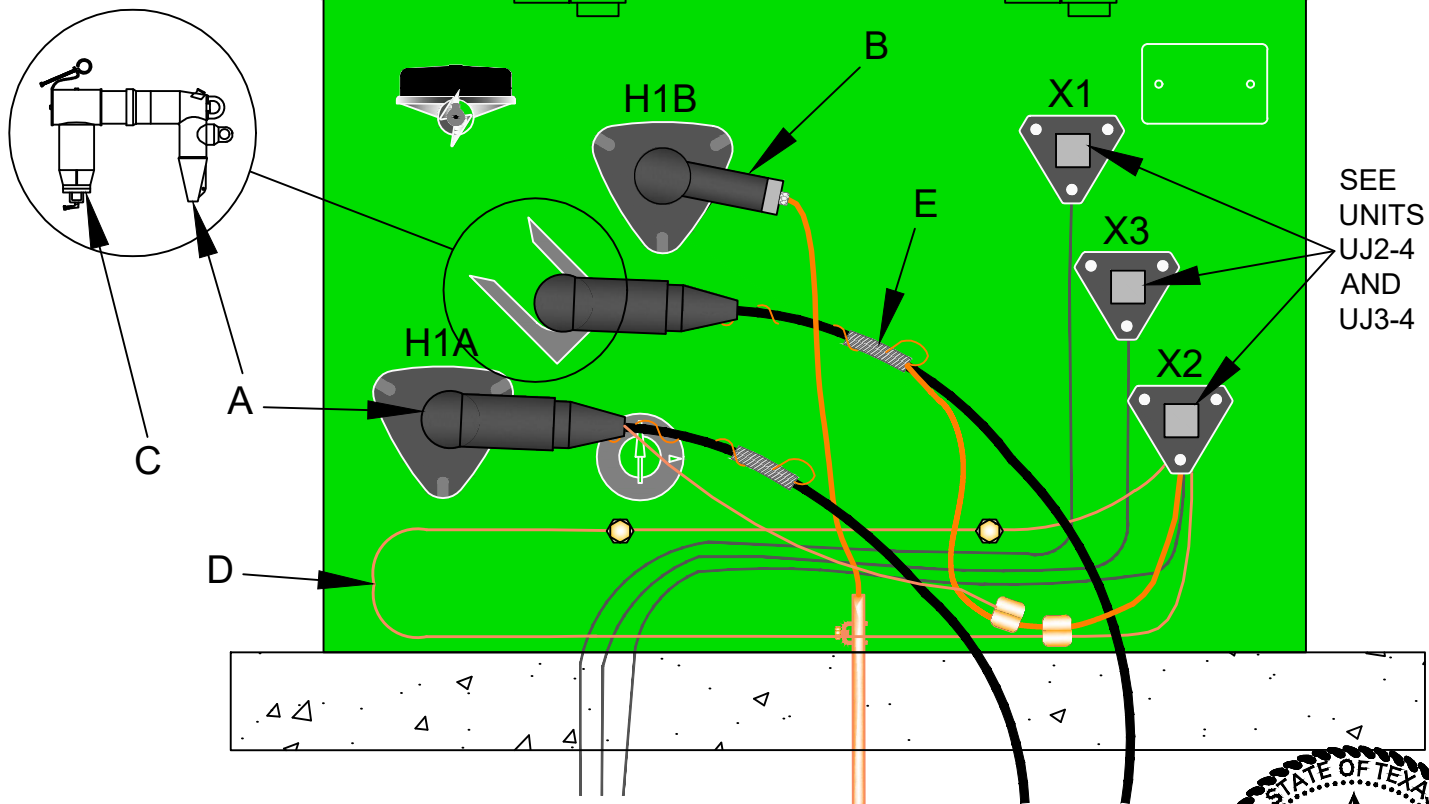

SEE UNITS UJ2-4 AND UJ3-4

**NOTES:**

1. BOND CONCENTRIC NEUTRALS TOGETHER USING APPROPRIATE NUMBER OF GROUND CLAMPS.
2. PROVIDE SUFFICIENT PRIMARY NEUTRAL PIGTAIL AND CABLE SLACK TO PERMIT READY DISCONNECTION OF ELBOW AND MOUNTING ON PARKING STAND.



*Michelle Galloway*  
 09/20/2018

ITEM	COMPATIBLE UNIT	QUANTITY	UNIT DESCRIPTION
A	VUM3-1	2	25kV PRIMARY CABLE TERMINAL
B	VUM5-9	1	18kV ARRESTER ELBOW
C	VUM5-10	1	ARRESTER PARKING STAND TYPE 18kV
D	N/A	AS REQ'D	2001295 - #6 BARE COPPER WIRE - SOLID SD
E	N/A	*2	2000558 - CABLE SEALING KIT (1/0)

**SPECIFY UJ2-4 FOR 25-75kVA XFMRs AND UJ3-4 for XFMRs LARGER THAN 75kVA**

\* DENOTES "GRAB BAG" ITEMS

REV | A | DATE | 09/21/2018 | REVISION | ISSUE FOR CONSTRUCTION | BY | RWC | CHK | EJD | APR | MMG



**MATERIAL SPECIFICATION**

1Ø PADMOUNT TRANSFORMER  
 TWO WAY FEED

drawn:	approved:	date:	101-003
RWC	MMG	08/31/2018	